


Single DNAPL Well Using 2550ES Controller For Class I, Div 1 Hazardous Areas

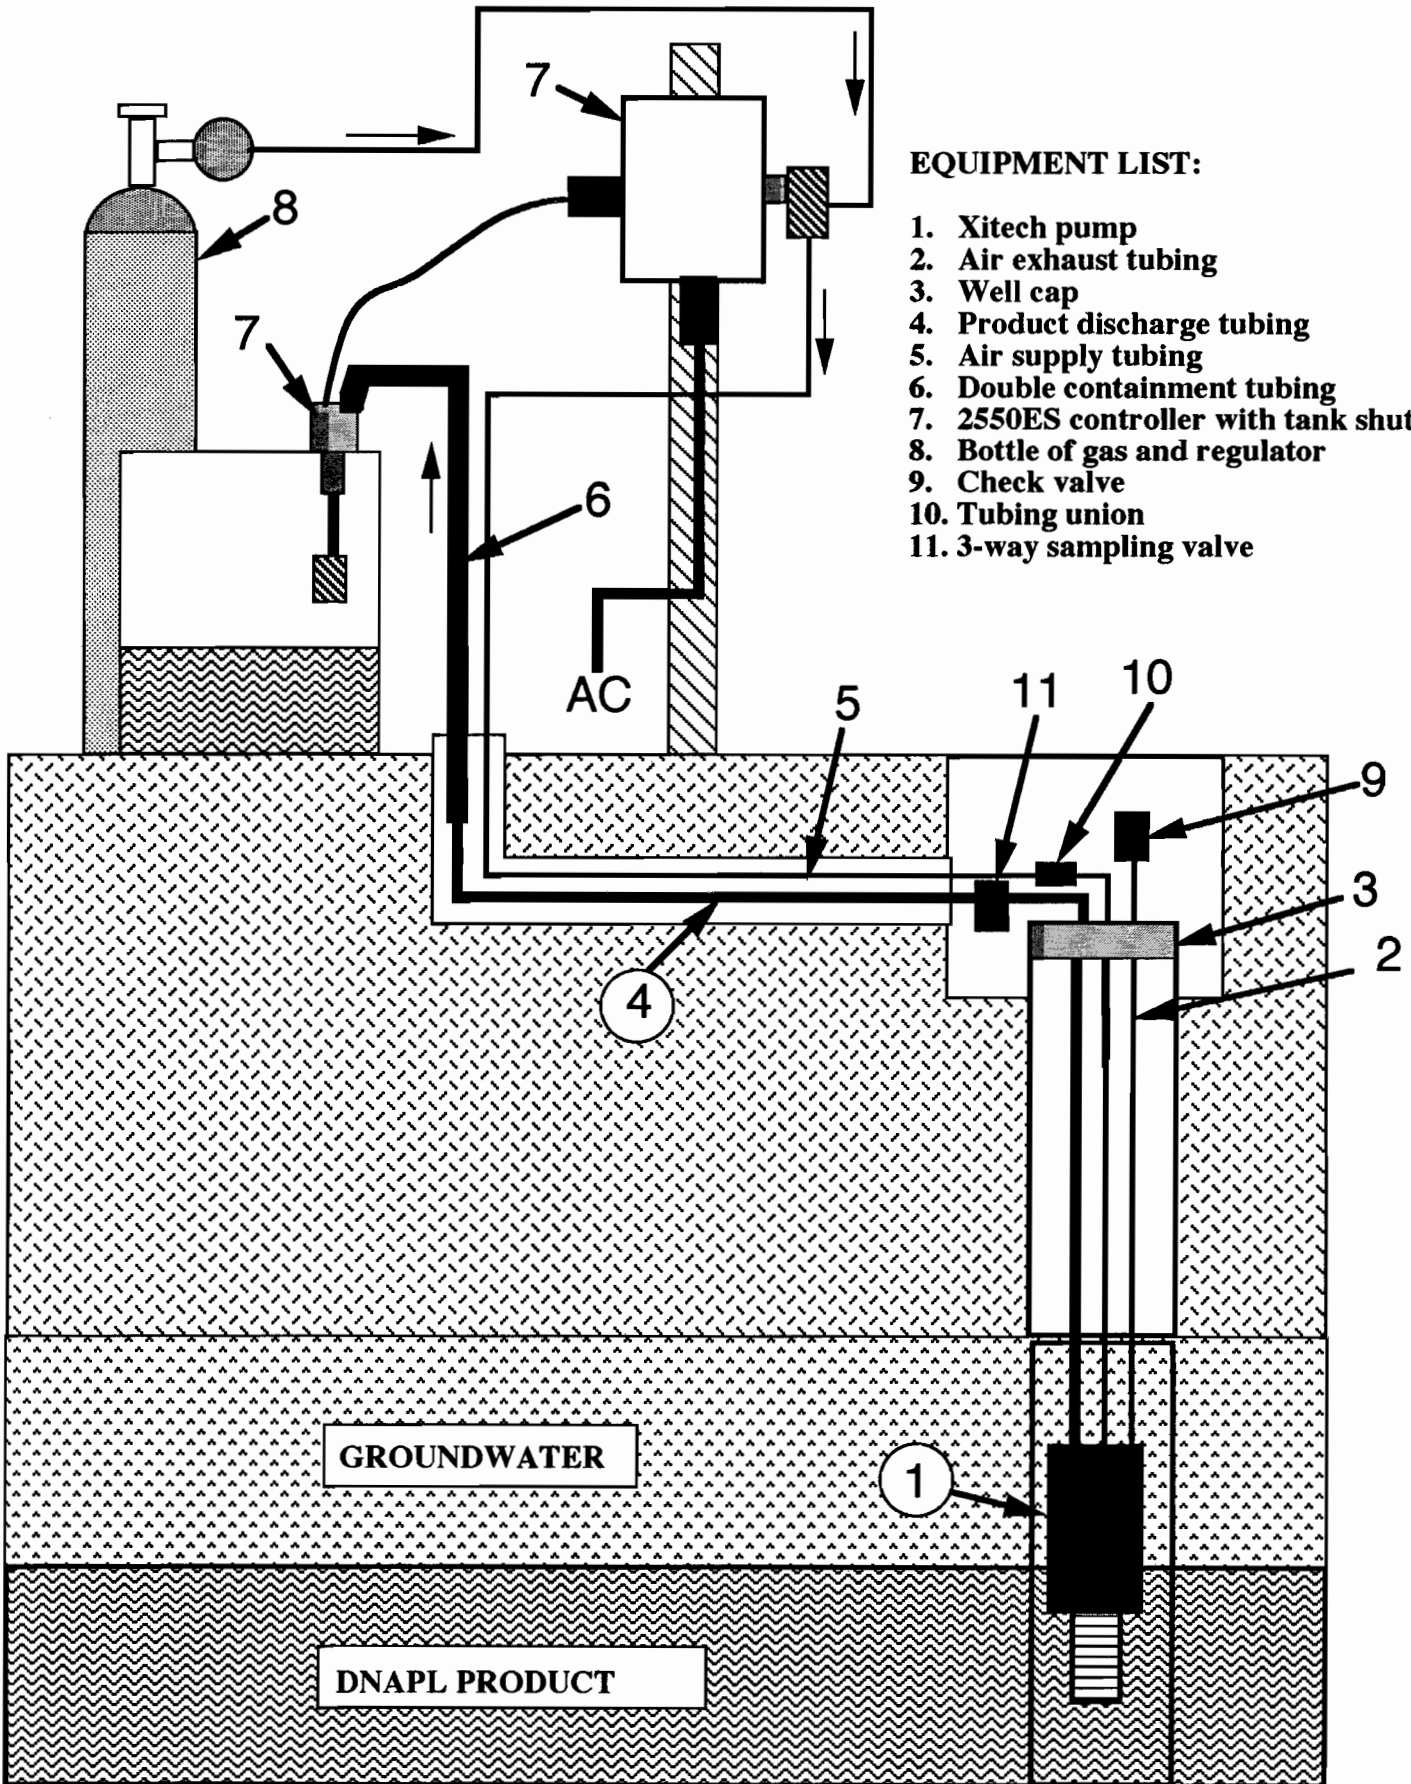

EQUIPMENT LIST:

1. Xitech pump
2. Air exhaust tubing
3. Well cap
4. Product discharge tubing
5. Air supply tubing
6. Double containment tubing
7. 2550ES controller with tank shutoff
8. Bottle of gas and regulator
9. Check valve
10. Tubing union
11. 3-way sampling valve